



Networked Lighting Control System Technical Requirements

Version NLC5

Released: June 23, 2020

Updated: October 7, 2022

This version of the Technical Requirements document contains updates and clarifications made to the originally released document, which are displayed as Policy Clarifications and Updates in Table 4 at the end of this document, and are highlighted in yellow.

Schedule of Revisions

Revision No.	Date	Description
1.0	Apr 21, 2016	<ul style="list-style-type: none">Initial Technical Requirements published.
1.01	May 7, 2016	<ul style="list-style-type: none">Clarified that the Technical Requirements are for interior control systems. Systems designed and marketed exclusively for exterior applications are not eligible to be qualified.
1.02	Feb 24, 2017	<ul style="list-style-type: none">Clarified that the Technical Requirements do not cover DC or PoE systems.
2.0	Jun 1, 2017	<ul style="list-style-type: none">Version 2.0 published, with addition of exterior control systems.
3.0	Jun 1, 2018	<ul style="list-style-type: none">Version 3.0 published, with addition of DC/PoE systems, scenes, and multi-year plans for energy monitoring and cybersecurity.
4.0	Jun 10, 2019	<ul style="list-style-type: none">Version 4.0 published, with addition of energy monitoring requirement, criteria for cybersecurity certifications, and building management systems capable of networked lighting control.
5.0	June 23 2020	<ul style="list-style-type: none">NLC5 published, with addition of cybersecurity requirement. Energy monitoring definition aligned with ASHRAE 90.1-2016. Three capabilities labeled as supporting Interoperability.

This document defines requirements to be met or reported for lighting control systems listed on the DesignLights Consortium (DLC) Networked Lighting Controls Qualified Products List (QPL).



14 **Contents**

15 Schedule of Revisions 1

16 Scope of Technical Requirements 3

17 Definition of “Required” vs. “Reported” Capabilities 3

18 Additional Requirements (in addition to Tables 1, 2, 3) 4

19 Multi-Year Plans 6

20 Interoperability..... 6

21 Cybersecurity..... 10

22 Delisting and Next Release 13

23 Requirements for Interior Lighting Systems..... 14

24 Requirements for Exterior Lighting Systems..... 15

25 Capability and Requirement Definitions 16

26 Policy Clarifications and Updates 21

27

28

29 Scope of Technical Requirements

30 These are requirements for interior and exterior networked lighting control (NLC) systems associated with
31 commercial and industrial buildings, roadways, and exterior environments. Note that while the DLC accepts
32 exterior NLC systems, these systems are not addressed comprehensively at present. NLC systems are defined
33 for the purposes of these requirements as the combination of sensors, network interfaces, and controllers
34 that effect lighting changes in luminaires, retrofit kits or lamps. Luminaires, retrofit kits and lamps are qualified
35 separately by the DLC's [Solid-State Lighting Technical Requirements](#) and [Qualified Products List](#).

36 DC and PoE networked lighting control systems are eligible to be qualified, in conjunction with the [SSL Testing
37 and Reporting Requirements for DC and PoE Lamps, Luminaires, and Retrofit Kits](#).

38 Building Management Systems that control networked lighting plus other building systems, such as HVAC, are
39 eligible to be qualified as NLC systems and listed on the QPL, provided that they meet all of the DLC's
40 requirements for NLC. Note that the DLC does not claim to qualify any HVAC-specific capabilities of these
41 systems at this time.

42 Horticultural control systems are not eligible to be qualified at this time.

43 Definition of “Required” vs. “Reported” Capabilities

44 The Technical Requirements are built on “Required” and “Reported” system capabilities.

45 **“Required” Capabilities:** Required capabilities shall be available in all systems to be listed on the QPL. Systems
46 that do not offer these capabilities are not eligible to be listed. A successful application will provide
47 information on the availability of these capabilities and characteristics. Key information provided by the
48 manufacturer will be published on the QPL.

49 *Note:* While the DLC requires systems to offer a particular capability, the DLC does not specify whether a
50 capability must be installed on a project. For instance, while the DLC requires systems to have daylight
51 harvesting/photocell capability, the DLC does not specify which rooms or luminaires on a project must be
52 installed with daylight harvesting/photocell capability. Project-specific requirements for rebates and incentives
53 are determined by individual efficiency programs.

54 **“Reported” Capabilities:** The DLC will report on the presence or absence of, type, and/or characteristics of
55 each Reported capability for qualified systems. While systems are not required to include these capabilities, a
56 successful application will provide information on the presence or absence of these capabilities and their
57 characteristics. Key information provided by the manufacturer will be published on the QPL.

58

59 Additional Requirements (in addition to Tables 1, 2, 3)

60 **“Customer Available Information”**: In order for an applicant to claim a capability listed in Tables 1 and 2, the
61 manufacturer’s customer literature must specify that the system has the capability, with instructions for how
62 to configure and/or use this feature.

63 “Customer available” means the documentation is for a finished product available publicly on a website,
64 and/or included with the product packaging, and/or provided to the customer upon request. It should not be a
65 document produced for the sole purpose of obtaining DLC qualification without further use for customers. The
66 DLC reserves the right to accept, reject, or require changes to documentation to satisfy this requirement. Any
67 documentation provided to the DLC will be used for the purpose of verifying compliance with DLC Technical
68 Requirements and will not be made available publicly or distributed.

69 The following capabilities from Table 1 and 2 are exempt from this requirement:

- 70 • Continuous Dimming
- 71 • Individual Addressability
- 72 • Luminaire Level Lighting Control (LLLC, integrated)
- 73 • Networking
- 74 • Ease of Implementation
- 75 • Type of User Interface
- 76 • Cybersecurity
- 77 • Control Persistence

78 **Warranty**: The DLC requires a minimum warranty of at least 5 years for all components of the system
79 addressed by the requirements, with the exception of software, on-premises computer server, and cloud
80 service. An optional warranty extension to 5 years is acceptable for meeting this requirement; however, the
81 QPL will identify that an extended warranty must be purchased to meet the requirements.

82 **Commercial Availability and Verification**: All systems must be fully commercially available in the U.S and/or
83 Canada, able to be purchased, and with complete, final documentation and literature readily available on the
84 manufacturer’s website before they can be listed. The DLC requires that a qualified system has been installed
85 and operated successfully in at least one actual field installation at a third-party site (not occupied by the
86 applicant or an agent of the applicant). The DLC will verify this through a case study and/or a customer
87 reference. The facility can be of any size where all of the required capabilities are functional. Multiple sites
88 may be used; for instance, occupancy sensing may be implemented at one site and high-end trim at another. If
89 daylight harvest is not available at a third-party site, then it can be demonstrated in an installation at a
90 building owned by the manufacturer, in a live webinar. Daylight harvest is the only required capability eligible
91 for this exception.

92 **Manufacturers of private label systems may submit an application two weeks before the system is launched.**
93 **This approach requires the private label applicant to submit a letter of intent (template available [here](#)) during**
94 **the application submission process confirming that the system will be launched within two weeks. When the**
95 **system is commercially available, the applicant must notify the DLC at info@designlights.org. If the system is**
96 **not yet commercially available after the two-week launch window, it will be temporarily delisted from the NLC**
97 **QPL until it has been launched.**

98 **System Overview Presentation:** As part of the application review process, the DLC requires a system overview
99 to be presented via webinar or in-person to the DLC. See the application form for more information. For
100 annual re-listings of a previously qualified system for which a recording of a prior presentation is available and
101 the system has not changed extensively, this requirement may be waived or shortened.

102 All requirements documents, including the application form, instructions, and supporting documentation can
103 be found at <https://www.designlights.org/our-work/networked-lighting-controls/qualify-a-system/>.

104

105 Multi-Year Plans

106 In order to serve the needs of stakeholders for long term planning, the DLC has included multi-year plans for
107 energy monitoring and cybersecurity in versions 3.0, 4.0, and now 5.0 of the Technical Requirements. These
108 plans have outlined a general direction for each topic, subject to refinement through the stakeholder input
109 process. After the release of NLC5, the DLC will develop a new multi-year plan for NLC. The process will involve
110 extensive stakeholder engagement, including virtual and/or in person event(s).

111 Interoperability

112 Building systems, including networked lighting control (NLC) systems, increasingly need to cooperate and
113 communicate with other systems beyond their boundaries to achieve a higher level of operational efficiency
114 and energy savings. This communication of systems or system components and the ability to act upon the
115 communicated information is called “interoperability”. Interoperability among building components and
116 systems is the key enabler for unlocking the benefits from multi-system operation and optimization. For
117 background context, please see a report by the DLC, [“Interoperability for Networked Lighting Controls”](#),
118 published May 2020.

119 Interoperability is recognized in NLC5 as a new type of NLC capability. The interoperability capabilities shown
120 in Tables 1.1 and 2.1 below will assist in selection of products that support interoperability in relation to
121 specific use cases. Over time, the DLC plans to recognize additional use cases and to report the system
122 capabilities that support these use cases in order to assist end users in choosing appropriate systems for
123 various uses. As a starting point, the DLC has identified three use cases for initial priority in reporting
124 interoperability. These three use cases are addressed by three corresponding capabilities: External Systems
125 Integration, Load Shedding/Demand Response, and Energy Monitoring. Within the interoperability umbrella,
126 the basic energy monitoring capability is “Required”, while advanced aspects of energy monitoring, such as
127 data content and format, are “Reported”. Other capabilities are “Reported”, but not “Required”, as described
128 in the section above ‘Definition of “Required” vs. “Reported” Capabilities’. The DLC continues to track relevant
129 standards as they develop.

130 Descriptions of the 3 initial interoperability use cases:

131 1. External Systems Integration

132 **Description:** Data from NLC components, such as luminaires, sensors, and controllers, is made
133 available through an Application Programming Interface (API) or BMS¹, and can be utilized by other
134 building systems to improve their operational efficiencies. Accessing the NLC component data using
135 the API or BMS allows integration with other building systems, including the Heating Ventilation and
136 Air Conditioning (HVAC) system, energy management system, security system, etc. For example, an
137 HVAC system might use occupancy data from an NLC system.

138 **Reporting:** An example of data about external systems integration that already exists in the DLC
139 database is occupancy data granularity. Under NLC5, this data will be presented on the QPL as an

¹ While open BMS protocols can be used instead of API, the need for extensive customized site-specific programming may limit the scalability of integration.

140 aspect of interoperability. The NLC5 application will include additional “Reported” questions regarding
141 communications with external systems through APIs and reporting frequency/latency/format.

142 2. Load Shedding/Demand Response (LS/DR)

143 **Description:** *Basic/1-way:* A demand response signal is received by an NLC system, and the energy
144 consumption of the system is reduced in a pre-defined way, on a temporary basis, without manual
145 intervention. *Advanced/2-way:* A control feedback loop and communication is established between a
146 building’s demand response server and a demand control originator (such as a grid operator, energy
147 provider, microgrid, or onsite Distributed Energy Resource), so that the building modifies its real-time
148 energy consumption in response to the originator’s needs, and reports the results to the originator.
149 The NLC participates in this ecosystem as one of the load-responding building systems.

150 **Reporting:** Examples of data about communication for LS/DR² that already exist in the DLC database
151 include power data availability, granularity, and accuracy; and supported versions of OpenADR. The
152 NLC5 application may include additional “Reported” questions regarding LS/DR. The DLC will work
153 with a multi-stakeholder group to explore LS/DR 1-way and 2-way communication, and to promote an
154 ecosystem of load responding building systems that meet the requirements of Table 3, Row 16.

155 3. Energy Monitoring (EM)

156 **Description:** Lighting system energy data is reported by the NLC and can be shared electronically
157 (automatically or manually generated email) with authorized entities. For example, utility energy
158 efficiency programs for NLCs can receive the energy data to verify energy savings. The lighting energy
159 data may also be accessed for central display of facility energy end-use status or for a building
160 portfolio management provider to benchmark energy performance. Ideally, the data will use a
161 standardized data model, when available.

162 **Requirement:** The basic capability of energy monitoring is “Required”, with an exception for room-
163 based systems. Data is reported via a .CSV file and/or an API. Methods of energy monitoring may
164 include automated measurement methods and methods that require manual input of wattage to
165 measure energy use. As part of the application or re-application process, each product that qualifies
166 for energy monitoring must provide the DLC with a sample .CSV file or API documentation.

167 **Energy monitoring capability is not required for room-based systems.** A “room-based system” is
168 defined as follows: A system that is designed to control lighting in a single room or space, and where
169 the control, configuration, and management of the system is contained within the room or space
170 illuminated by the system. In order to interact with the system, (for instance, to change any settings or
171 to download any data), a user must be physically present in, or in close proximity to, the room or
172 space illuminated by the system.

173 In order for a system to qualify for this exemption, the DLC review process confirms that the product
174 claims only “Room or Zone” for interior scope as listed on the DLC QPL; and that if a room based

² For a recent exploration of this topic, see “The Value Proposition for Cost-Effective, Demand Responsive-Enabling, Nonresidential Lighting System Retrofits in California Buildings”, April 2019, Peter Schwartz et al, <https://www.energy.ca.gov/2019publications/CEC-500-2019-041/CEC-500-2019-041.pdf>

175 system is capable of being upgraded with an internet connection, then that upgraded system shall
 176 meet all of the required capabilities of the Technical Requirements and be listed on the QPL.

177 The basic capability of energy monitoring is loosely aligned with ASHRAE 90.1-2016 Section 8.4.3
 178 “Electrical Energy Monitoring”, as outlined below in Table 3, Row 11.

179 Advanced capabilities of energy monitoring are “Reported”.

180 In the absence of a more detailed applicable standard (beyond ASHRAE 90.1) describing energy data
 181 reports, details about data content in the following tables are “Reported”, not “Required”.

182 Tables EM-1 and EM-2 describe the recommended (but not required) contents of an energy
 183 monitoring data report. The Online NLC QPL will report which systems offer these contents. This table
 184 is derived from the DLC report [“Energy Savings from Networked Lighting Control \(NLC\) Systems”](#),
 185 9/21/2017, Appendix A, Tables 8 and 9. The DLC is participating in the ANSI/NEMA C137 Committee to
 186 develop more specific data requirements. In the meantime, the required content of an energy
 187 monitoring data report is described in Table 3, Row 11.

188 **Table EM-1: Recommended Energy Data Reporting Guidelines for .CSV or API; Static Data**

Row	Topic	Data Element	Definition	Note
1.1	Headings	For each field	Each type of data element is identified by a heading.	Text such as “Manufacturer”, “Product”, etc.
1.2	System	Manufacturer	The manufacturer of the NLC system	Text
1.3	System	Product	The name of the NLC system	Text
1.4	Site	Building/Business Type [<i>*Note A</i>]	The main business function in the portion of the building where the NLC system is installed	From ASHRAE 90.1-2016 Table 9.5.1
1.5	Baseline for NLC	Maximum Rated Power with no control strategy enabled	The maximum possible power consumption of the lighting system without any control strategy in effect. If a luminaire retrofit has occurred, this value is equal to the maximum rated power of the new luminaire(s). The spatial granularity matches the energy measurements. For instance, if energy is reported at each luminaire, then the baseline power is reported at each luminaire.	Separate data for interior vs. exterior. Units = kilowatts
1.6	Energy	Energy Reporting Interval [<i>*Note B</i>]	The frequency an energy measurement is reported (15 minutes or less)	Units = minutes
1.7	Energy	Data method	How is energy interval data calculated?	Text such as “15 minute average from 3 samples spaced 5 minutes apart”
1.8	Energy	Energy Data units	Energy data is in Wh or kWh?	Units = text such as “Wh” or “kWh”

189 **Table EM-2: Recommended Energy Data Reporting Guidelines for .CSV or API; Dynamic Variables**

Row	Topic	Data Element	Definition	Note
2.1	Headings	For each field	Each type of data element is identified by a heading.	Text such as “Unix Time”, “Energy Data kWh”, etc.
2.2	Energy	Timestamp	Date and time of each energy measurement	Unix time or RFC 3339 time
2.3	Energy	Energy Data	The actual energy readings that are recorded for each luminaire or group of luminaires	Units = kWh or Wh
2.4	Energy	Confidence Level	The percentage of all possible samples expected to include the true population parameter.	Units = %
2.5	Energy	Nominal Accuracy	% accuracy of the energy data [<i>*Note C</i>]	Text such as “+/-3% or 0.005 kWh, whichever is larger”
2.6	Energy	Recorded Period	Months of 15 minute interval data in this particular record	Units=months

190 **Note A:** For Building/Business Type, ASHRAE Standard 90.1-2016, “Energy Standard for Buildings Except Low-
 191 Rise Residential Buildings” Table 9.5.1 can be viewed at [https://www.ashrae.org/technical-
 192 resources/standards-and-guidelines/read-only-versions-of-ashrae-standards](https://www.ashrae.org/technical-resources/standards-and-guidelines/read-only-versions-of-ashrae-standards), PDF page 155.

193 **Note B:** The need for 15 minute interval data is derived from the IPMVP Options A and B, as typically
 194 implemented by utility programs (International Performance Measurement and Verification Protocol:
 195 Core Concepts and Options for Determining Energy and Water Savings EVO-10000-1.2016, Efficiency
 196 Valuation Organization, evo-world.org.)

197 **Note C:** The accuracy of the energy data as defined by the manufacturer. In the future, the DLC expects to
 198 recognize standards of accuracy as they become available from ANSI C136 and C137.

199 **Future plans for interoperability:**

- 200 • **Additional Use Cases**
 201 Use cases in the future may involve additional capabilities beyond the three in NLC5.

202 Cybersecurity

203 In alignment with the multi-year cybersecurity plan previously published in versions 3.0 and 4.0 of this
204 document, the DLC is taking the next step to help ensure qualified systems utilize best-practice standards for
205 cybersecurity. The cybersecurity capability is “Required” under NLC5. The criteria have been expanded from
206 NLC V4.0 to offer more options for compliance.

- 207 • While the standards in Table CS-1 and services in Table CS-2 can be applied to NLCs, not all of their
208 requirements may be relevant for various applications of lighting control systems.
- 209 • Manufacturers and their certification bodies should review each option to identify the appropriate
210 requirements for each system being qualified, and customers should select product requirements
211 based on the risk profile of each project.
- 212 • In order to claim the cybersecurity capability, a system must, at the time of qualification, have a valid
213 certification for one or more of the specified standards in Table CS-1, or services in Table CS-2.
- 214 • The list of applicable standards in Table CS-1 and services in Table CS-2 will be reviewed for each
215 incremental revision to the Technical Requirements, or annually, whichever comes sooner.
216 Applications referring to a potential new standard or service will only be accepted for review after the
217 new standard or service has been vetted, and an updated set of Technical Requirement has been
218 published. The addition of a new standard or service may only warrant a minor Technical
219 Requirements update, such as from NLC5 to NLC5.1.
- 220 • Certification in any one of the four categories of Table CS-1 (Process, Components, System, Cloud
221 Services) is sufficient.
- 222 • Table CS-3 describes how DLC reviewers will confirm compliance.
- 223 • The DLC will confirm that cybersecurity certification will be valid for at least 12 months after the time
224 of application submission. If the certification will expire within a year, the NLC manufacturer will need
225 to submit a letter of intention of renewal with the application and will need to provide an updated
226 certificate upon its expiration, in compliance with Table CS-2 or CS-3, to avoid being delisted.
- 227 • The DLC will confirm cybersecurity certification once a year in July, whether or not a system updates
228 data to the next Technical Requirements version. If a certificate has lapsed, a system will need to
229 recertify in order to avoid being delisted.
- 230 • Some cybersecurity certifications offer different levels of compliance based on risk management. For
231 instance, some standards offer lower performance requirements for room level systems that cannot
232 be upgraded to add a permanent internet connection. Therefore, the DLC cybersecurity requirement
233 applies to all systems—with the understanding that comprehensive systems with many capabilities are
234 subject to more rigor, compared to simple systems with few capabilities.
- 235 • The grace period for renewals is described below under “Delisting and Next Release”. For the new
236 cybersecurity requirement introduced with NLC5, the same grace period is extended to products that
237 have not been previously listed on the DLC QPL.

238



239 **Criteria for acceptable cybersecurity standards:**

240 The DLC recognizes the cybersecurity standards listed in Table CS-1 that meet criteria 1-3 below, and the
241 cybersecurity services listed in Table CS-2 that meet criteria 2-3 below:

- 242 1. Certifiable with a methodology established through either:
- 243 a. A voluntary consensus process such as ANSI, ISO, IEC, etc.
 - 244 b. A federal agency of the USA or Canada
 - 245 c. A collaborative multi-stakeholder engagement process such as the Cloud Security Alliance
- 246 2. Applies to one or more of the following:
- 247 a. Product development process lifecycle
 - 248 b. Components/Embedded Devices
 - 249 c. System
 - 250 d. Cloud Services
- 251 3. Includes at least 3 of the following technical content, for (2. b, c, d) above:
- 252 a. Penetration testing
 - 253 b. Communication robustness testing
 - 254 c. Vulnerability identification testing
 - 255 d. Multiple levels of security

256 **Definitions:**

- 257 • **Cybersecurity:** The practice of defending networked systems and data from malicious attacks.
- 258 • **Process:** Standards that address the development process in order to reduce the number of
259 cybersecurity vulnerabilities that are designed into components, systems, and services, and that
260 manifest over the product lifecycle.
- 261 • **Components:** Standards that address the cybersecurity of each individual physical end device in a
262 networked system.
- 263 • **System:** Standards that address the networked system, including aspects such as authentication, data
264 confidentiality, system integrity, service availability, protocol converters, firewalls, gateways, web
265 servers, and web services interfaces.
- 266 • **Cloud Services:** Standards for cloud services that address secure integration with services from a
267 remote cloud computing provider.

268 **List of certifications:**

269 Certifications that meet the criteria are listed in Tables CS-1 and CS-2. Once a certification is on this list, the
270 DLC does not expect to remove it with less than two years of notice.

271 **Future plans for cybersecurity:**

272 The DLC plans to maintain cybersecurity requirements similar to NLC5 for at least two years, with the possible
273 addition of new standards as they become available, and minor changes in language if needed for clarification.
274 In the meantime, development efforts will explore the potential for more substantial updates after two or
275 more years, to keep pace with the fields of cybersecurity and cyber privacy.

276 **Table CS-1: Cybersecurity Standards Recognized by the DLC**

Standard	Process	Components/ Embedded Devices	System	Cloud Services
ANSI/UL 2900-1	y	y		
ANSI/ISA/IEC 62443	62443-4-1	62443-4-2	62443-3-3	
SOC 2	y		y	y
ISO 27001	y			
ISO 27017 (with 27001)				y
FedRAMP				y
CSA STAR				y
ioXt		y	y	y
PSA Certified*		y	y	

277 * Chip Level 2 or 3; with System Software Level 1,2 or 3 and/or Device Level 1,2 or 3

278 **Table CS-2: Cybersecurity Services Recognized by the DLC**

Service	Proof of Compliance
UL IoT Security Rating (UL 1376)	Copy of certificate or letter from UL
CSA Cybersecurity Verification Program (CVP) (CSA T200)	Copy of certificate or letter from CSA
Intertek Cyber Assured	Copy of certificate or letter from Intertek

279

280 **Table CS-3: Proof of Cybersecurity Standard Compliance**

281 *Renewal is required at least every 3 years in order for a certificate to remain valid.*

Standard	Proof of Compliance
ANSI/UL 2900-1	Certification claim listed on applicant’s website, plus a compliance letter or copy of certificate issued by an accredited certification body.
IEC 62443	ISASecure registry of a component, system, or Certified Development Organization at https://www.isasecure.org/en-US/End-Users/ or Copy of IECEE certificate, or listed at https://certificates.iecee.org/ods/cb_hm.xsp or Copy of certificate from other accredited agency, such as UL, VDE, DEKRA, etc.
SOC 2	Certification claim listed on applicant’s website, plus a compliance letter from 3 rd party auditor.
ISO 27001	Copy of an accredited certification from a member of the ANSI-ASQ National Accreditation Board as listed at http://anabdirectory.remoteauditor.com/ or Copy of an accredited certification from an organization accredited as “Management Systems Certification Bodies” for ISO 27001 by the International Accreditation Service (IAS) at https://www.iasonline.org/search-accredited-organizations-2/
ISO 27017 (with 27001)	Copy of an accredited certification from a member of the ANSI-ASQ National Accreditation Board as listed at http://anabdirectory.remoteauditor.com/

FedRAMP	“Authorized” at https://marketplace.fedramp.gov/#/products?status=Compliant;FedRAMP%20Ready&sort=productName
CSA STAR	“Certification” or “Attestation” at https://cloudsecurityalliance.org/star/registry/
ioXt	Copy of ioXt certificate or letter from accredited testing organization or certified at https://compliance.ioxtalliance.org/products
PSA Certified	Listed at https://www.psacertified.org/certified-products/ with Chip Level 2 or 3; plus System Software Level 1,2 or 3 and/or Device Level 1,2 or 3

282

283 Delisting and Next Release

284 NLC Version 3.0 delisting:


285 NLC3 listed systems will be delisted on October 31, 2020, unless they have been updated to NLC5 with
 286 cybersecurity.

287 NLC Version 4.0 delisting:

288 Any NLC4 systems that have not been updated to NLC5 (that is, that do not have DLC-recognized
 289 cybersecurity) will be delisted on February 28, 2022. (This date has been extended from October 31, 2021
 290 because of COVID-19-related complications in product development.) Before February 28, 2022, if a new
 291 system applies without cybersecurity or a listed system reapplies without cybersecurity, the system will be
 292 listed as NLC4 until proof of cybersecurity is submitted. When cybersecurity proof is accepted by the DLC, the
 293 listing version will be updated to match the application version most recently submitted for that system.

294 Timeline of the next Technical Requirements release:

295 **The current plan for delisting products qualified as NLC4 is shown below.** Delisting of products without
 296 cybersecurity will occur on February 28, 2022.

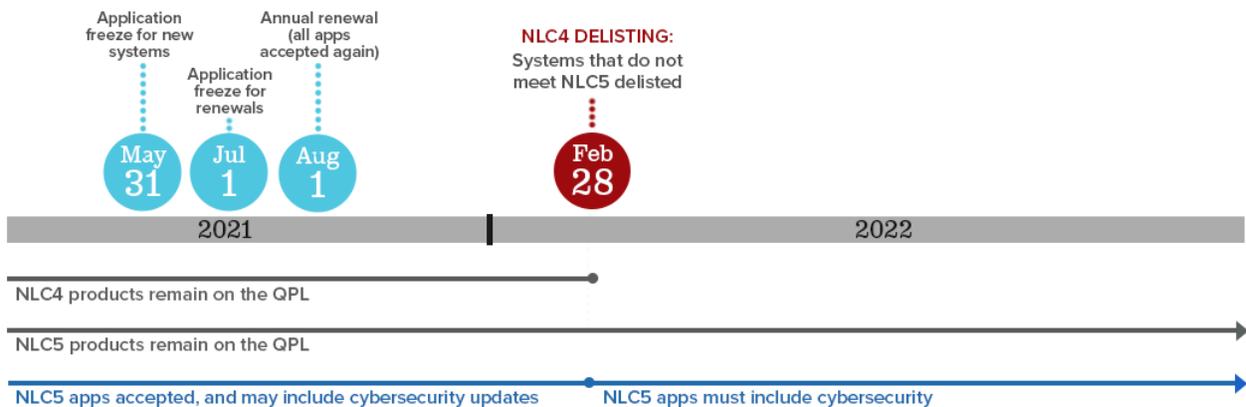

297

298 **Requirements for Interior Lighting Systems**

299 For interior lighting systems, Table 1 summarizes general “Required” and “Reported” system capabilities, and
 300 Table 1.1 summarizes “Required” and “Reported” system capabilities pertaining to Interoperability.

301 **Table 1: “Required” and “Reported” Capabilities for Interior Lighting Systems**

‘Required’ Interior System Capabilities	‘Reported’ Interior System Capabilities
Networking of Luminaires and Devices	Control Persistence
Occupancy Sensing	Scheduling
Daylight Harvesting/Photocell Control	Device Monitoring/Remote Diagnostics
High-End Trim	Type of User Interface
Zoning	Luminaire Level Lighting Control (LLLC, integrated)
Individual Addressability	Personal Control
Continuous Dimming	Plug Load Control
Cybersecurity	Emergency Lighting
	Color Changing/Tuning
	Ease of Implementation
	Scene Control

302

303 **Table 1.1: Interior Lighting System Capabilities Focused on Interoperability**

‘Required’ Interior System Capabilities	‘Reported’ Interior System Capabilities
Energy Monitoring (except room-based systems)	Energy Monitoring (room-based systems)
	Load Shedding/Demand Response
	External Systems Integration

304

305

306 **Requirements for Exterior Lighting Systems**

307 For exterior lighting systems, Table 2 summarizes general “Required” and “Reported” system capabilities, and
 308 Table 2.1 summarizes “Required” and “Reported” system capabilities pertaining to Interoperability.

309 **Table 2: “Required” and “Reported” Capabilities for Exterior Lighting Systems**

‘Required’ Exterior System Capabilities	‘Reported’ Exterior System Capabilities
Networking of Luminaires and Devices	Control Persistence
Occupancy Sensing AND/OR Traffic Sensing	Device Monitoring/Remote Diagnostics
Daylight Harvesting/Photocell Control	Type of User Interface
High-End Trim	Luminaire Level Lighting Control (LLLC, integrated)
Zoning	Emergency Lighting
Individual Addressability	Color Changing/Tuning
Continuous Dimming	Ease of Implementation
Scheduling	Scene Control
Cybersecurity	

310

311 **Table 2.1: Exterior Lighting System Capabilities Focused on Interoperability**

‘Required’ Exterior System Capabilities	‘Reported’ Exterior System Capabilities
Energy Monitoring	Load Shedding/Demand Response
	External Systems Integration

312

313 Capability and Requirement Definitions

314 Table 3 provides a definition of each capability. This table applies to both Interior and Exterior systems, except
 315 where noted. If an applicant answers ‘yes’ to a capability definition in Table 3, that capability can be claimed.
 316 If an applicant answers ‘no’, then the capability cannot be claimed. The DLC NLC application form specifies in
 317 more detail the information the DLC asks about each capability, and the information that will be published on
 318 the QPL. Beyond the basic definitions shown in Table 3, the DLC NLC application contains additional questions
 319 about most capabilities. After answering ‘yes’ to the first key question about a capability, an applicant can
 320 answer additional questions about that capability with any well-documented response.

321 Note: Some NLC systems control luminaires and retrofit kits, and some NLC systems control lamps within
 322 luminaires. The latter systems use a wireless controller integrated inside each lamp. The “luminaires/lamps”
 323 phrase indicates that a requirement applies to luminaires and retrofit kits if an NLC system controls luminaires
 324 and retrofit kits; and the requirement applies to lamps if an NLC system controls lamps.

325 **Table 3: Definitions of Capabilities & Requirements**

Row	Capability	Definition
1	Networking of Luminaires and Devices	The capability of individual luminaires/lamps and control devices to exchange digital data with other luminaires/lamps and control devices on the system. This capability is required at the room, space, or area level, but not at the whole building level or beyond (e.g. non-lighting systems, or the internet).
2	Occupancy Sensing	The capability to affect the operation of lighting equipment based upon detecting the presence or absence of people in a space or exterior environment. Exterior systems must include either occupancy sensing or traffic sensing. They may include both, but that is not required.
3	Traffic Sensing	The capability to affect the operation of lighting or other equipment based upon detecting the presence or absence of moving vehicles in an area. Systems may satisfy this requirement through external systems integration as described below in lieu of in-system sensors if another source of data is used for presence or absence detection. Exterior systems must include either occupancy sensing or traffic sensing. They may include both, but that is not required.
4	Daylight Harvesting / Photocell Control	The capability to automatically affect the operation of lighting or other equipment based on the amount of daylight and/or ambient light that is present in a space, area, or exterior environment. This capability is typically called daylight harvesting for interior systems, and photocell control for exterior systems.

Row	Capability	Definition
5	High-End Trim*	<p>The capability to set the maximum light output to a less-than-maximum state of an individual or group of luminaires/lamps at the time of installation or commissioning. High-end trim must be field reconfigurable. This capability is distinct from automatic compensation for lumen depreciation, which automatically increases output as a system operates over time.</p> <p>*While the DLC specifically requires “High-end trim”, some manufacturers refer to this capability as “task tuning” or “tuning” within their system interfaces. Refer to NEMA LSD 64-2014 for definitions of lighting controls terminology.</p>
6	Zoning	<p>The capability to group luminaires/lamps and form unique lighting control zones for a control strategy via software-defined means, and not via physical configuration of mechanical or electrical installation details (e.g. wiring).</p> <p><i>Interior:</i> Zoning is required for occupancy sensing, high-end trim, and daylight harvesting control strategies except for systems that feature luminaire level lighting control (LLLC) capabilities as defined in these requirements under “Reported Capabilities”, in which case zoning is only required for occupancy sensing and high-end trim control strategies.</p> <p><i>Exterior:</i> Zoning is required for high-end trim.</p>
7	Individual Addressability	<p>The ability to uniquely identify and/or address each individual luminaire/lamp, sensor, controller, and user interface device in the lighting system, allowing for configuration and re-configuration of devices and control zones independent of electrical circuiting.</p>
8	Continuous Dimming	<p>The capability of a control system to provide control with sufficient resolution in output (100+ steps) to support light level changes perceived as smooth (as opposed to step dimming with a small number of discrete light levels).</p>
9	Control Persistence	<p>The capability of a networked lighting control system’s lowest-level (“edge device”) luminaire/lamp controllers to execute three energy saving strategies (occupancy sensing, daylight harvesting, and high-end trim) at a room-level, or finer, resolution in the absence of communications with the next higher networked element in the system’s topology.</p>
10	Scheduling	<p>The capability to automatically affect the operation of lighting equipment based on time of day. Scheduling capability is reported for interior systems and required for exterior systems. Exterior systems are required to have time-based scheduling, and "astronomical" scheduling functionality for sunrise and sunset programming, based on geographical location and time of year.</p>

Row	Capability	Definition
11	Energy Monitoring	<p>The capability of a system to report the energy consumption of a luminaire/lamp and/or a group of luminaires/lamps.</p> <ul style="list-style-type: none"> • Individual luminaire/lamp monitoring as well as energy monitoring on dedicated lighting circuits is acceptable. • The method by which the system implements this capability must be clearly described, including whether the system provides automated energy measurement or relies on numerical manual input during system setup for accurate measurement (such as inputting the wattage of each luminaire/lamp in a project). • Reference consists of one or both of: <ul style="list-style-type: none"> ○ Sample .CSV file with documentation ○ API documentation • The basic, “required” capability of energy monitoring is aligned with ASHRAE 90.1-2016 Section 8.4.3. as follows: <ul style="list-style-type: none"> ○ Energy use by interior lighting (if applicable), exterior lighting (if applicable) and receptacle circuits (if monitored by the NLC) can be monitored independently. ○ For buildings with tenants, the data for each tenant space can be reported to each tenant. ○ Energy use data can be transmitted to a building control system (if present) and graphically displayed. ○ The lighting system energy use can be recorded and stored in either of the two ways described below. <ol style="list-style-type: none"> 1) Data is recorded at least once every 15 minutes and reported at least hourly, daily, monthly, and annually, or recorded and reported upon state change, with data stored for at least 24 months, or 2) At any time during the first year after original configuration, the preceding 4 weeks of 15-minute interval data can be reported, and daily interval data can be reported since original configuration. • Energy monitoring is “reported” for room-based systems, but not “required”. In order for room-based systems to claim the optional energy monitoring capability: <ul style="list-style-type: none"> ○ Energy data can be retrieved by a user in the room when required - hourly, daily, monthly or yearly; or on demand. ○ Energy data can be retrieved in the form of a CSV file and/or API. • In order for a system to qualify for the room-based exemption, the DLC review process will confirm that the product claims only “Room or Zone” for interior scope as listed on the DLC QPL.

Row	Capability	Definition
12	Device Monitoring / Remote Diagnostics	The capability to monitor, diagnose, and report operational performance including system and/or component failures.
13	Type of User Interface	The type of interface provided by the control system for users to read and adjust control system settings during system start-up, commissioning, and/or ongoing operation.
14	Luminaire Level Lighting Control (LLLC, integrated)	<p>The capability to have a networked occupancy sensor and ambient light sensor installed for each luminaire or kit, and directly integrated or embedded into the form factor during the luminaire or kit manufacturing process.</p> <p>In addition to these required integrated components, LLLC systems must have control persistence capability as described in this document.</p> <p>To demonstrate commercial availability of the integrated component options, at least one family, luminaire or kit with integrated control must be verified by the DLC. Manufacturers may choose whether or not to list this information publicly on the QPL.</p>
15	Personal Control	<p>The capability for individual users to adjust to their personal preferences, via networked means, the illuminated environment of a light fixture or group of light fixtures in a specific task area. The publicly available information must clearly describe a control interface for use by a single individual who does not have access to system-wide settings.</p> <p>A wireless dimmer switch may only be considered a personal control interface if product documentation:</p> <ul style="list-style-type: none"> • shows that the physical configuration is suitable for workstation use (i.e. a small, self-contained unit without any external wiring, suitable for use as a handheld remote control), and • describes configuration for personal control within a larger area. <p>A software-based interface may only be considered personal control if product documentation:</p> <ul style="list-style-type: none"> • shows it provides a specific interface intended for personal control by an individual user within a subsection of a larger space, and that • the interface only allows access to personal control functions for the light fixtures in the specific areas being controlled (i.e. each occupant can control their own area, but not their neighbors' areas).
16	Load Shedding/ Demand Response	The capability to reduce the energy consumption of a lighting system, in a pre-defined way, on a temporary basis, in response to a demand response signal without manual intervention. The method by which the system implements this capability (managed by NLC and/or BMS) must be clearly described in the publicly available reference(s). The method for pre-defining the system behavior for temporary load reduction must be accessible through a user interface. The data the NLC can receive and interpret from other networked systems must include at least a signal that can be used for purposes such as LS/DR.

Row	Capability	Definition
17	Plug Load Control	The capability to control the power delivered to receptacles through scheduling or occupancy sensing. The method by which the system implements this capability must be clearly described in the publicly available reference(s).
18	External Systems Integration (e.g. BMS, EMS, HVAC, Lighting, API, Cloud)	The capability to exchange data with other networked systems such as building or energy management systems (BMS/EMS), heating ventilation and air conditioning (HVAC) systems, or other lighting and building systems via BACnet, Modbus, LonWorks or other open protocols, application program interface (API) or other methods. In order to claim this “Reported” capability, the data available from the NLC for exchange with other networked systems must include occupancy status at the zone, space, or area level and energy data at the zone-, circuit- or system-level. The data the NLC can receive and interpret from other networked systems must be digital, that can be used for purposes such as scene control, zones, groups, areas, regions, and/or presets. The method, including formats and languages, by which the system implements this capability must be clearly described in the publicly available reference(s).
19	Emergency Lighting	Publicly available documentation illustrating how a system’s luminaires connect with an emergency power source. The QPL will provide the URL(s) for online documentation provided by manufacturers for system designers to refer to. This documentation will identify wiring diagrams, required components, and/or application guides needed to understand design considerations for integrating the system into an emergency lighting system.
20	Cybersecurity	A cybersecurity certification that meets the DLC criteria. The current standards are shown in Table CS-1 and listed here: <ul style="list-style-type: none"> • ANSI/UL 2900-1 • IEC 62443 • SOC 2 • ISO 27001 • ISO 27017 (with 27001) • FedRAMP • CSA STAR • ioXt The current services are shown in Table CS-2 and listed here: <ul style="list-style-type: none"> • UL IoT Security Rating (UL 1376) • CSA Cybersecurity Verification Program (CVP) (CSA T200) • Intertek Cyber Assured Documentation requirements to demonstrate certification are shown in Tables CS-2 and CS-3.

Row	Capability	Definition
21	Color Changing / Tuning	The capability to alter the output and color of tunable white and/or variable color output luminaires via a dedicated control interface(s). To demonstrate compliance with this capability, the interface(s) must be clearly described in the product literature and allow for at least two CCT settings. These settings may be described in terms of CCT, such as 3000K or 5000K, or simple descriptive terms for the desired setting such as 'Night' or 'Day'. The product literature must also specify installation and configuration requirements to implement this functionality.
22	Ease of Implementation	The QPL will identify the most typical responsible party and their required level of training to start-up and configure the system to the extent that all required capabilities are functioning. Documentation is not required.
23	Scenes	The capability of a system to provide two or more pre-programmed light level settings for a group or multiple groups of luminaires to suit multiple activities in a space, and allow for recall of these settings via a switch, control device, or signal from a BMS or API.

326

327 Policy Clarifications and Updates

328 As the DLC processes applications for NLC5 and interacts with stakeholders, we encounter opportunities for
 329 minor corrections, terminology clarifications, and policy interpretations. In order to be as transparent as
 330 possible, the NLC Technical Requirements will be updated as needed, and the changes will be tracked in the
 331 table below and on the [DLC website](#). **Table 4** shows the corrections or clarifications and where they can be
 332 found in the document.

333 **Table 1: Updates and Clarifications, Published as Needed**

Date Updated	Subject	Change Type	Description	Affected Page(s)
1/18/2020	Schedule	Schedule change	NLC6 final release moved from 2021 to 2022	12
12/22/2021	Cyber-security	Add a standard	Recognize PSA-Certified Cybersecurity certification with Level 2 or 3 chip certification	11
12/22/2021	Cyber-security	Add a method of compliance	Recognize International Accreditation Service - IAS for ISO 27001	11
12/22/2021	Timeline	Update	NLC6 final release will be later than 2022	12
10/7/2022	Commercial Availability and Verification	Expand eligibility	Accept private label applications that will launch within 2 weeks of submission.	4

Date Updated	Subject	Change Type	Description	Affected Page(s)
10/7/2022	Energy Monitoring	Expand eligibility	Accept 4 weeks of 15-minute interval data plus 12 months of daily interval data, during the first year	18

334